



# YORK®

## Heating and Air Conditioning

### TECHNICAL GUIDE

#### AFFINITY

#### MODELS: PT9

#### GAS-FIRED

#### CONDENSING / HIGH EFFICIENCY

#### DOWNFLOW/HORIZONTAL

#### TWO STAGE FURNACES

#### NATURAL GAS

#### 60 - 120 MBH INPUT



Due to continuous product improvement, specifications are subject to change without notice.

Visit us on the web at [www.york.com](http://www.york.com) for the most up-to-date technical information.

Additional rating information can be found at [www.gamanet.org](http://www.gamanet.org).

### DESCRIPTION

These Category IV, highly efficient, compact, condensing type furnaces are designed for residential and commercial installations in a basement, closet, alcove, recreation room or garage where the ambient temperature is above 32°F, or higher. They may be either side wall or thru-roof vented using approved plastic type combustion air and vent piping. All units are factory assembled, wired and tested to assure dependable and economical installation and operation.

### WARRANTY


*Lifetime limited warranty on both heat exchangers to the original purchaser; a 20-year limited warranty from original installation date to subsequent purchaser.*

*10-year warranty on commercial applications.*

*5-year limited parts warranty.*

### FEATURES

- Two stage heating operation includes:
  - Two stage gas valve
  - Two stage inducer operation
- Provides increased comfort level & very quiet unit operation.
- Adjustable delay timer allows two stage operation with single stage thermostat.
- Compact, easy to install, ideal height 40" cabinet.
- Blower-off delay for cooling SEER improvement.
- Easy to connect power/control wiring.
- Built-in, high level self diagnostics with fault code display.
- Low unit amp requirement for easy replacement application.
- Integrated control module for reliable, economical operation.
- May be installed as either two-pipe (sealed combustion) or single pipe vent (using indoor combustion air).
- Top intake & vent connection allows installation in narrow locations.
- Electronic Hot Surface Ignition saves fuel cost with increased dependability and reliability.
- Induced combustion system with inshot main burners for quiet, efficient operation.
- No special vent termination kit required.
- 100% shut off main gas valve for extra safety.
- PSC - four speed, direct drive motor with large, quiet blower.
- 24V, 40 VA control transformer and blower relay supplied for add-on cooling.
- Hi-tech tubular aluminized steel primary heat exchanger.
- Secondary (condensing) heat exchanger of 29-4C high-grade stainless steel.
- Timed on, adjustable off blower capability for maximum comfort.
- Independent door removal for greater durability and ease of access.
- Easy access from front of unit for cleaning, maintenance or service.
- Protection from intake, exhaust or condensate blockage.
- Insulated blower compartment for quiet operation.
- 3-way transition facilitates fresh air piping.

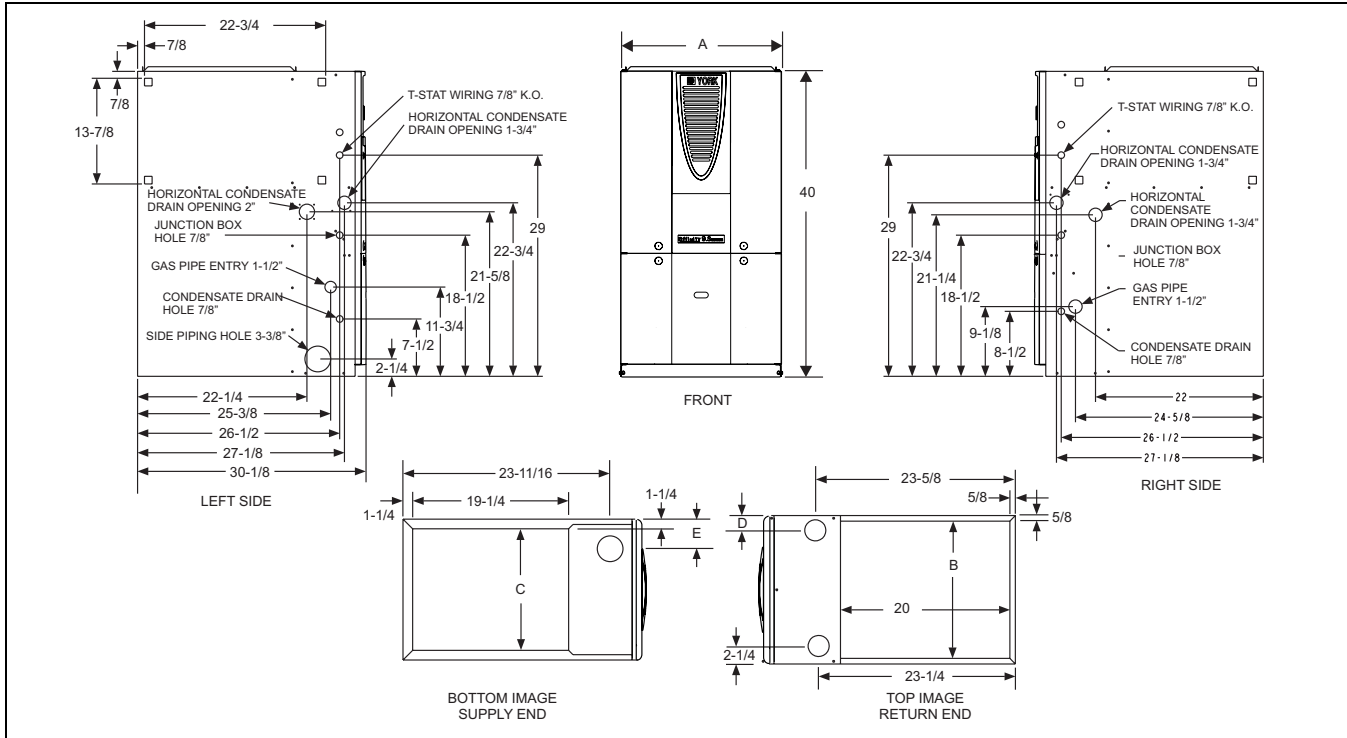

**CABINET AND DUCT DIMENSIONS**

Models	CFM	CABINET SIZE	CABINET DIMENSION				
			A (IN.)	B (IN.)	C (IN.)	D (IN.)	E (IN.)
PT9B12N060DH11	1200	B	17-1/2	16-1/4	15	1-3/4	2-3/8
PT9B12N080DH11	1200	B	17-1/2	16-1/4	15	1-3/4	2-3/8
PT9C16N080DH11	1600	C	21	19-3/4	18-1/2	2-1/8	2-3/4
PT9C20N100DH11	2000	C	21	19-3/4	18-1/2	2-1/8	2-3/4
PT9D20N120DH11	2000	D	24-1/2	23-1/4	22	2-1/2	3

**ELECTRICAL AND PERFORMANCE DATA**

Models	Input (High/Low)	Output (High/Low)	Nominal Airflow	Cabinet Width	Total Unit	AFUE	Air Temp. Rise
	MBH	MBH	CFM	In.	Amps	%	°F
PT9B12N060DH11	60 / 39	56 / 36	1200	17-1/2	9	92	35 - 65
PT9B12N080DH11	80 / 52	75 / 49	1200	17-1/2	9	92	35 - 65
PT9C16N080DH11	80 / 52	75 / 49	1600	21	12	92	35 - 65
PT9C20N100DH11	100 / 65	93 / 61	2000	21	14	92	35 - 65
PT9D20N120DH11	120 / 78	112 / 74	2000	24-1/2	14	92	35 - 65

Models	Input (High/Low)	Max. Outlet Air Temp.	Blower		Blower Size	Max. Over-current Protect	Min. Wire Size (awg) @ 75 ft. One Way	Operating Weight
	MBH	°F	HP	Amps	In.			Lbs.
PT9B12N060DH11	60 / 39	165	1/2	7.0	11 x 8	20	14	136
PT9B12N080DH11	80 / 52	165	1/2	7.0	11 x 8	20	14	143
PT9C16N080DH11	80 / 52	165	3/4	10.2	11 x 10	20	14	159
PT9C20N100DH11	100 / 65	165	1	12.7	11 x 11	20	12	164
PT9D20N120DH11	120 / 78	165	1	12.7	11 x 11	20	12	182

Annual Fuel Utilization Efficiency (AFUE) numbers are determined in accordance with DOE Test procedures.  
 Wire size and over current protection must comply with the National Electrical Code (NFPA-70-latest edition) and all local codes.  
 The furnace shall be installed so that the electrical components are protected from water.  
 \* Wire size and overcurrent protection must comply with the National Electric Code.

**NOTES:**

1. For altitudes above 2000 ft. reduce capacity 4% for each 1000 ft. above sea level.
2. Wire size based on copper conductors, 60°C, 3% voltage drop.
3. Continuous return air temperature must not be below 55°F.
4. All filters must be high velocity cleanable type.

**BLOWER PERFORMANCE CFM**

AIRFLOW WITH TOP RETURN - WITHOUT FILTERS											
Models	Speed Tap	EXTERNAL STATIC PRESSURE, INCHES W.C.									
		0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	0.9	1.0
		CFM	CFM	CFM	CFM	CFM	CFM	CFM	CFM	CFM	CFM
PT9B12N060DH11	High	1687	1652	1631	1595	1557	1511	1456	1382	1313	1211
	Medium High	1193	1183	1173	1162	1142	1115	1076	1036	982	950
	Medium Low	933	933	921	911	902	872	825	793	771	712
	Low	752	745	731	718	698	652	602	580	536	496
PT9B12N080DH11	High	1686	1658	1623	1572	1534	1465	1391	1305	1202	1091
	Medium High	1257	1223	1218	1203	1177	1142	1094	1026	939	874
	Medium Low	977	982	976	955	934	899	843	791	738	686
	Low	775	777	757	733	698	663	627	584	549	490
PT9C16N080DH11	High	2071	2026	1981	1935	1864	1796	1713	1625	1532	1401
	Medium High	1583	1590	1569	1554	1532	1502	1457	1409	1327	1221
	Medium Low	1256	1275	1275	1288	1275	1265	1232	1187	1126	1023
	Low	937	939	936	945	942	936	912	874	810	726
PT9C20N100DH11	High	2404	2320	2225	2138	2034	1924	1816	1692	1559	1422
	Medium High	2018	1955	1883	1815	1750	1670	1586	1497	1394	1246
	Medium Low	1626	1581	1531	1488	1418	1363	1291	1225	1123	964
	Low	1336	1291	1249	1205	1155	1091	1018	951	884	759
PT9D20N120DH11	High	2520	2432	2353	2251	2152	2042	1947	1815	1701	1525
	Medium High	2018	1979	1945	1911	1863	1779	1705	1599	1493	1353
	Medium Low	1586	1545	1501	1457	1407	1351	1287	1216	1081	926
	Low	1321	1266	1213	1163	1111	1071	987	864	763	700

## NOTES:

1. Airflow expressed in standard cubic feet per minute.
2. Motor voltage at 115 V.

## FILTER PERFORMANCE

The airflow capacity data published in the "Blower Performance" table listed above represents blower performance WITHOUT filters. To determine the approximate blower performance of the system, apply the filter drop value for the filter being used or select an appropriate value from the "Filter Performance" table shown.

**NOTE:** The filter pressure drop values in the "Filter Performance" table shown are typical values for the type of filter listed and should only be used as a guideline. Actual pressure drop ratings for each filter type vary between filter manufacturer.

## RECOMMENDED FILTER SIZES

Input BTU/H	CFM	Cabinet Size	Top Return Filter in
60	1200	B	(2) 14 x 20
80	1200	B	(2) 14 x 20
80	1600	C	(2) 14 x 20
100	2000	C	(2) 14 x 20
120	2000	D	(2) 14 x 20

### NOTES:

1. Air velocity through throwaway type filters may not exceed 300 feet per minute. All velocities over this require the use of high velocity filters.

## APPLYING FILTER PRESSURE DROP TO DETERMINE SYSTEM AIRFLOW

To determine the approximate airflow of the unit with a filter in place, follow the steps below:

1. Select the filter type.
2. Determine the External System Static Pressure (ESP) without the filter.

3. Select a filter pressure drop from the table based upon the number of return air openings or return air opening size and add to the ESP from Step 3 to determine the total system static.
4. If total system static matches a ESP value in the airflow table (i.e. 0.20, 0.60, etc.) the system airflow corresponds to the intersection of the ESP column and Model/Blower Speed row.
5. If the total system static falls between ESP values in the table (i.e. 0.58, 0.75, etc.), the static pressure may be rounded to the nearest value in the table determining the airflow using Step 5 or calculate the airflow by using the following example.

**Example:** For a 120,000 Btuh furnace operating on high speed blower, it is found that total system static is 0.58" w.c. To determine the system airflow, complete the following steps:

1. Obtain the airflow values at 0.50" & 0.60" ESP.  
Airflow @ 0.50": 2152CFM  
Airflow @ 0.60": 2042 CFM
2. Subtract the airflow @ 0.50" from the airflow @ 0.60" to obtain airflow difference.  
 $2042 - 2152 = -110$  CFM  
Subtract the total system static from 0.50" and divide this difference by the difference in ESP values in the table, 0.60" - 0.50", to obtain a percentage.  
 $(0.58 - 0.50) / (0.60 - 0.50) = 0.8$
3. Multiply percentage by airflow difference to obtain airflow reduction.  
 $(0.8) \times (-110) = -88$
4. Subtract airflow reduction value to airflow @ 0.50" to obtain actual airflow @ 0.58" ESP.  
 $2152 - 88 = 2064$

## FILTER PERFORMANCE - PRESSURE DROP INCHES W.C.


Airflow Range	Minimum Opening Size	Filter Type		
		Disposable	Washable Fibers	Pleated
CFM	in <sup>2</sup>	In W.C.	In W.C.	In W.C.
0 - 750	230	0.01	0.01	0.15
751 - 1000	330	0.05	0.05	0.20
1001 - 1250	330	0.10	0.10	0.20
1251 - 1500	330	0.10	0.10	0.25
1501 - 1750	380	0.15	0.14	0.30
1751 - 2000	380	0.19	0.18	0.30
2001 & Above	463	0.19	0.18	0.30

## UNIT CLEARANCES TO COMBUSTIBLES

Application	Top	Front	Rear	Left Side	Right Side	Flue	Floor/Bottom	Closet	Alcove	Attic	Line Contact
	In.	In.	In.	In.	In.	In.	In.				
Downflow	1	3	0	0	0	0	1*	Yes	Yes	Yes	NA
Horizontal	0	3	0	1	1	0	0	Yes	Yes	Yes	Yes <sup>2</sup>

\* Combustible floor base or air conditioning coil required for use on combustible floor.



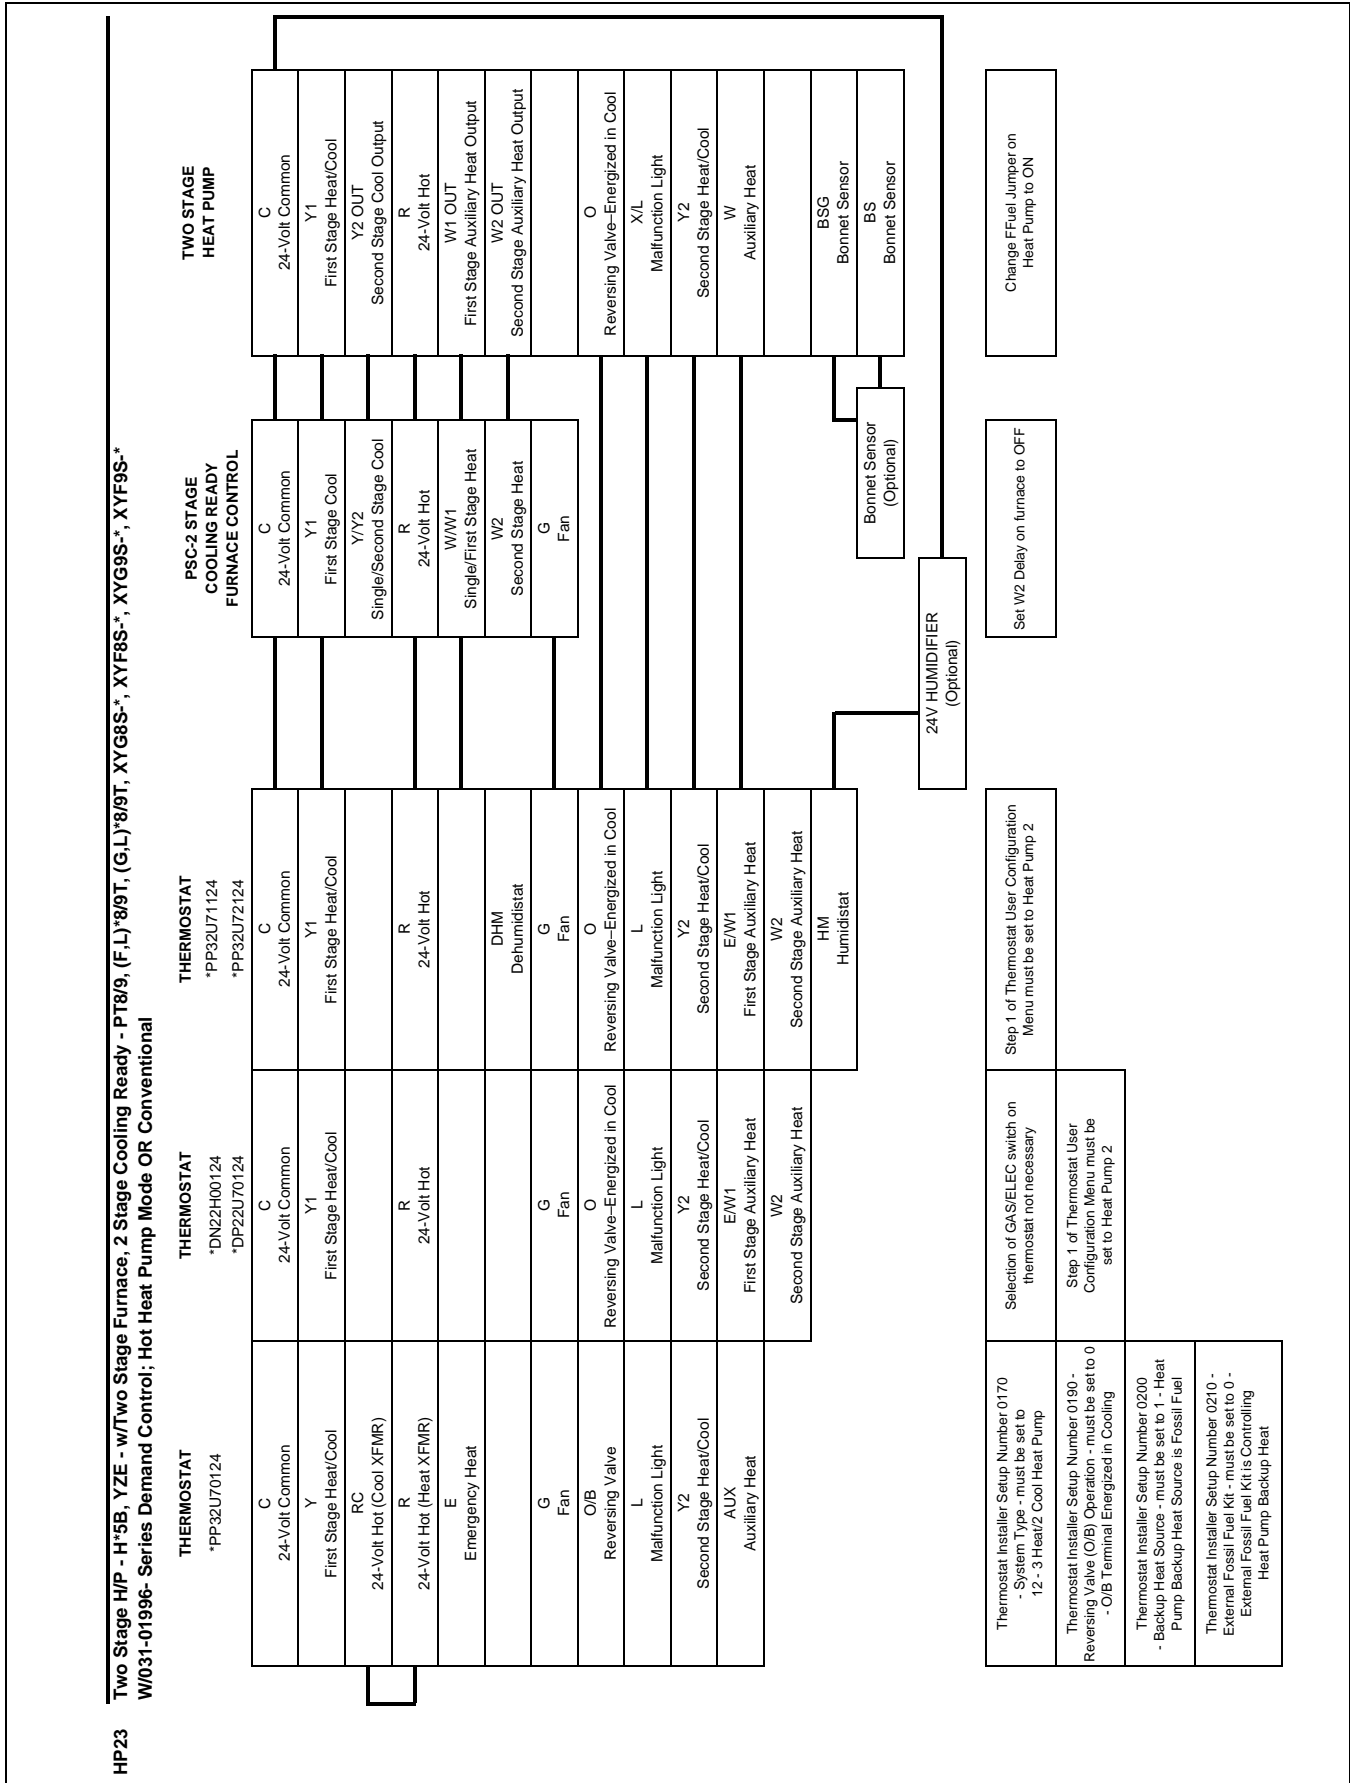

Thermostat Chart - HP

**ACCESSORIES****PROPANE (LP) CONVERSION KIT -**

1NP0347 - All units

This accessory conversion kit may be used to convert natural gas units for propane (LP) operation. Conversions must be made by qualified distributor or dealer personnel.

**CONCENTRIC VENT TERMINATION -**

1CT0302 (2")

1CT0303 (3")

For use through rooftop, sidewall. Allows combustion air to enter and exhaust to exit through single common hole. Eliminates unsightly elbows for a cleaner installation.

**SIDEWALL VENT TERMINATION KIT -**

1HT0901 (3")

1HT0902 (2")

For use on sidewall, two-pipe installations only. Provide a more attractive termination for locations where the terminal is visible on the side of the home.

**COMBUSTIBLE FLOOR BASE -**

1CB0317 - 17 1/2" Cabinet

1CB0321 - 21" Cabinet

1CB0324 - 24-1/2" Cabinet

**COIL TRANSITION KIT -**

1TK0917 - 17-1/2" Furnace

1TK0921 - 21" Furnace

1TK0924 - 24-1/2" Furnace

These kits are required in downflow application when using G\*F\* series coils. These kits are not required with MC/FC series coils, but please ensure that the coil and furnace are secured and that there are no air leaks.

**CONDENSATE NEUTRALIZER KIT - 1NK0301**

Neutralizer cartridge has a 1/2" plastic tube fittings for installation in the drain line. Calcium carbonate refill media is also available from the Source 1 Parts (p/n 026-30228-000).

**HIGH ALTITUDE PRESSURE SWITCHES -**

For installation where the altitude is less than 8,000 feet it is not required that the pressure switch be changed. For altitudes above 8,000 feet see kits below. Conversion must be made by qualified distributor or dealer personnel.

1PS0507 - 060 MBH

1PS0508 - 080/1200 MBH

1PS0509 - 080/1600 MBH

1PS0510 - 100 MBH

1PS0511 - 120 MBH

**ROOM THERMOSTATS** - A wide selection of compatible thermostats are available to provide optimum performance and features for any installation.

1H/1C, manual change-over electronic non-programmable thermostat.

1H/1C, auto/manual changeover, electronic programmable, deluxe 7-day, thermostat.

1H/1C, auto/manual changeover, electronic programmable.

\* For the most current accessory information, refer to the price book or consult factory.

